

CONTENTS	Page
1. Use.....	1
2. Technical characteristics.....	1
3. Navigation.....	2
4. Updating.....	5
5. Standard EN12464-1 recommendations.....	7
6. Care.....	8
7. Standards.....	8


1. USE

Using this infrared configuration tool the user can, without touching the device:

- set the parameters of SCS and KNX self-contained sensors, dynamic light strips and SARLAM bulkhead lights (time delay, daylight setpoint, detection sensitivity, etc.)
- adjust, correct, debug the system according to the characteristics of the installation location and customer requirements
- save the settings (maximum of up to 26 configuration files)
- duplicate onto other sensors (copy/paste a typical setting)

2. TECHNICAL CHARACTERISTICS

Infrared communication technology (4 m max.)
 In the direction of the product to be measured
 At a maximum angle of +/-15° in the axis of the IR transmission and reception LED (see figure)

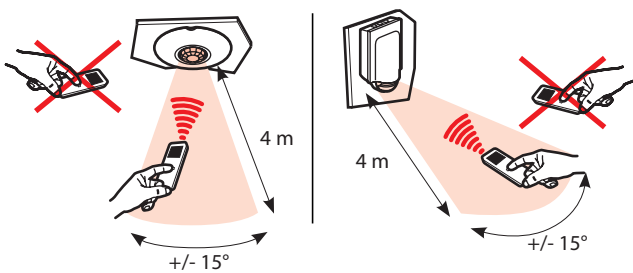


Backlit screen (automatic switch-off)
 Weight: 71 g
 Impact resistance: IK04
 Operating temperature: -5°C to +45°C
 Storage temperature: -20°C to +70°C

Recharging: Use a mini USB cable (not supplied) to recharge the configuration tool via a standard USB socket.

Note: Updating software is available on our website
www.legrandoc.com


2. TECHNICAL CHARACTERISTICS (CONTINUED)

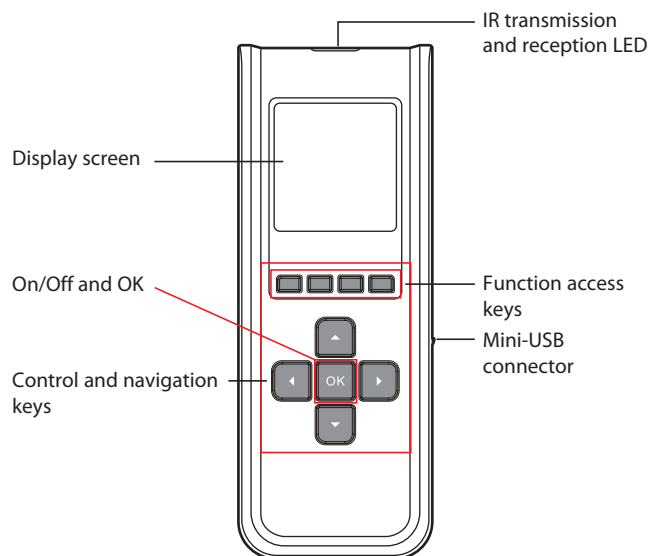

Works with all factory pre-set compatible sensors (infrared, ultrasound or dual technology) with dynamic light strips and SARLAM bulkhead lights.
 After fully interrogating the device, only the parameters concerning this device appear.

3. NAVIGATION

3.1 Pictograms



The 4 buttons control the pictogram functions displayed above

- Back to previous page
- Takes the current sensor configuration
- Sends a configuration to the sensor
- Creates a backup file
- Provides the website address for the online technical documents (www.legrandoc.com)
- Deletes a file
- Displays a file's parameters
- Deletes a product from the configuration
- Adds a product to the configuration
- Information

3.2 Instructions for use

3.2.1 Language selection

ON 2-3 s

1 Français English Italiano Español

2 Français English Italiano Español

3 Français English Italiano Español

x 2

3. NAVIGATION (CONTINUED)

3.2.2 Parameter selection

1 Sensor parameters > Advanced mode > Files > Sensor PnL

5 Test 6 Settings

1 Sensor parameters > Advanced mode > Files > Sensor PnL

A Time delay B Sensitivity C Daylight setpoint D Mode E Detection scheme F Alert G Standby level H Standby time

A Time delay
000 H 15 Min 00 Sec
Max. time delay 255 H 59 Min 59 Sec

B Sensitivity
PIR Very high <>
US High <>
HF High <>
Very high High Medium Low


C Daylight setpoint
0500 lux
Max: 1275 lux

D Mode
Auto on/off
Walkthrough
Manual on/Auto off
Partial on/Group off

E Detection scheme
Initial IR and US <>
Maintain IR or US <>
Retrigger IR or US <>
IR and US IR or US HF only PIR and HF IR only US only

F Alert
Audible
ON/OFF Status change "BEEP" on the sensor

3. NAVIGATION (CONTINUED)

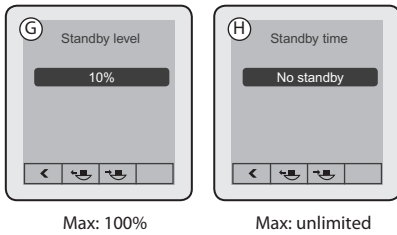

A Time delay

Length of time the load is on after detection. See technical data sheet for the associated sensor.

B Sensitivity

Sets the sensor range (see technical data sheet for the associated sensor).

C Daylight setpoint

Value at which the load switches on if the light level is less than the setting and goes off if it is above this setpoint. The daylight setpoint can be set up to a maximum of 1275 lux.

D Mode

There are 4 different operating modes.

Auto on/Auto off mode:

Comes on automatically:

- On detection of a presence if there is insufficient natural light.
 - Turns off automatically:
 - If no presence is detected and at the end of the time delay set.
 - Or if there is sufficient natural light (regulation function activated).
- Any new detection triggers an automatic switch-on if there is insufficient light.

Walk-through:

- If no presence is detected in the 3 minutes following an initial detection, the sensor will cut off the load after 3 minutes.
- If another movement is detected in the 3 minutes following initial detection, the device will cut off the load at the end of the set time delay.

Manual on/Auto off mode:

The lighting is switched on manually and switched off automatically:

- If no movement is detected at the end of the set time delay.

After switch-off, if another movement is detected within a 30-second period, the lighting switches on automatically. After 30 seconds, the lighting has to be switched on manually.

Partial on/Group off mode:

This mode is used to ungroup circuits that are switched on upon detection and circuits that will be switched off at the end of detection.

Example: Upon detection I switch on the main lighting and I can control backup lighting manually in parallel. At the end of detection, the sensor controls switching off the main lighting and the backup lighting circuits.

E Detection scheme

This menu concerns the detection technologies. There are several possible types of combination.

IR and US: The sensor needs both technologies in order to switch on the load.

IR or US: The sensor needs one of these technologies in order to switch on the load.

HF only: The sensor needs HF technology in order to switch on the load.

3. NAVIGATION (CONTINUED)

IR only: The sensor needs IR technology in order to switch on the load.
US only: The sensor needs US technology in order to switch on the load.

F Alert

A "BEEP" is transmitted before the end of the time delay programmed.

G Standby level



Warns of switch-off by lowering the light level before switch-off.

H Standby time


Used to adjust the switch-off warning duration.

NB: Choosing an unlimited duration allows there to be a minimum light level when no presence is detected.



3.2.3 Advanced mode

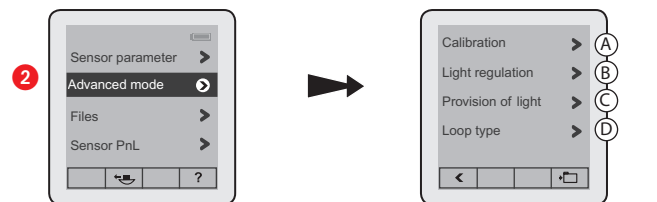

Max. lux: 99,995



Max. lux: 1275



Closed loop
Open loop

A Calibration

In order to calibrate the sensor, the surrounding light level must first be measured using a luxmeter. The measured surrounding light level should then be transmitted to the sensor.

Steps for setting the electric light factor:

- Put the light on and close the shutters
- Wait 2 minutes
- Measure the light level below the cell using a luxmeter

Enter this value in the tool and send it to the cell. This calibration will be acknowledged during the next detection cycle.

3. NAVIGATION (CONTINUED)

B Light regulation

Principle: Light regulation distinguishes between the available natural light and the provision of artificial light. It continuously measures the natural light level (daylight) and compensates for the lack of this natural light level by switching on the artificial light.

The light level cell distinguishes between the available natural light and that provided by artificial light and, by comparing with the daylight setpoint, the product adjusts the provision of artificial light. The daylight setpoint set in the products is a threshold below which the area being lit must not fall, as indicated in standard NF 12464-1.

C Provision of light

This is the quantity of additional lux contributed by switching on the artificial light.

D Loop type

There should be outside light available for correct operation of the regulation function.


Closed loop:

The sensor measures the light level in its coverage area and regulates the lighting according to this measurement.


Open loop:

The sensor does not measure the light level in its coverage area. The lighting is regulated according to the available outside light.

3.2.4 Files

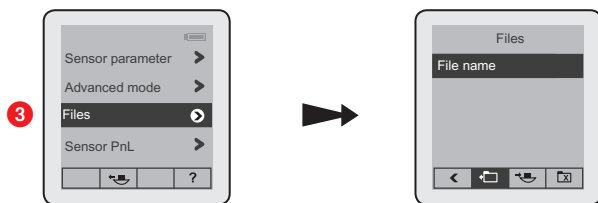


Example

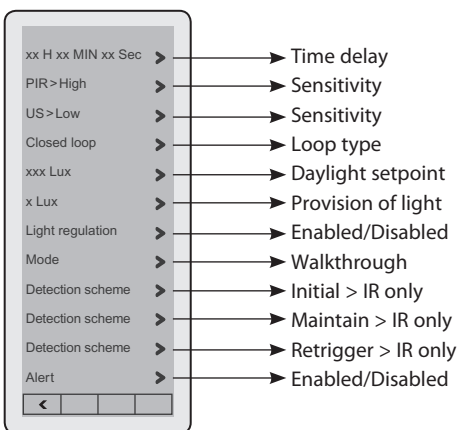

The "Files" menu can be used to display the customised settings saved. Up to 26 files can be saved.

3. NAVIGATION (CONTINUED)


3.2.5 Sensor PnL

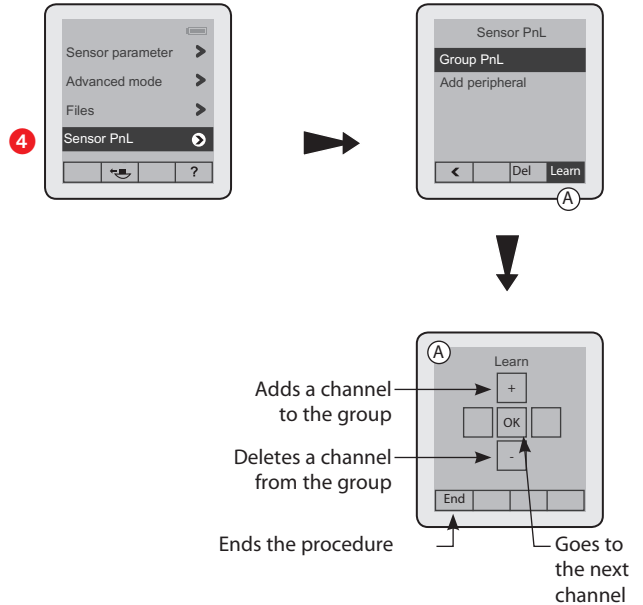

PnL = Push & Learn

Teach mode allowing several products to be combined in a system. The configuration tool allows this function to be used remotely.

3.2.6 Test

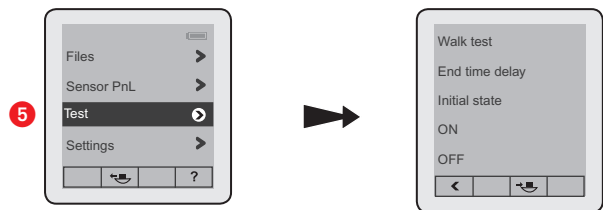

Walk test

Mode used to check how the installation is operating. When the command is sent, the sensor goes into test mode for 5 minutes. The sensor is therefore in Auto ON/Auto OFF mode and the time delay is set at 5 sec.

End time delay

Used to force the end of the current time delay.

Initial state

Used to exit Test mode and puts the installation into operating mode (initial state). This function does not modify the selected parameters.

ON


Used to force switch-on.

OFF

Used to force switch-off.

3. NAVIGATION (CONTINUED)

■ 3.2.7 Settings

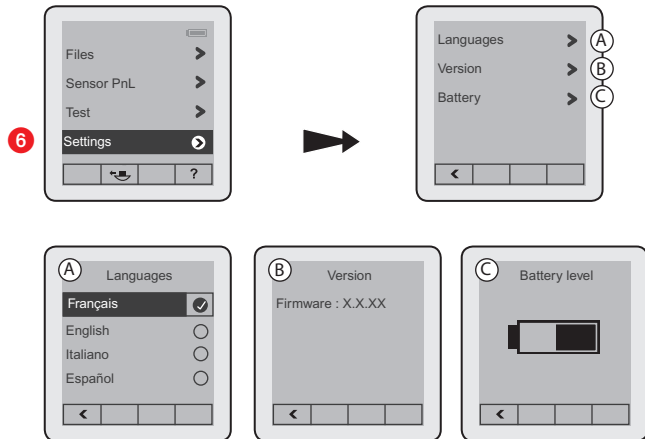


4. UPDATING

■ 4.1 Installing the software

1 Connect to the website www.legrandoc.com





2 Enter product catalogue number **0 882 30**



then click **OK**


The page concerning the available product documentation is displayed

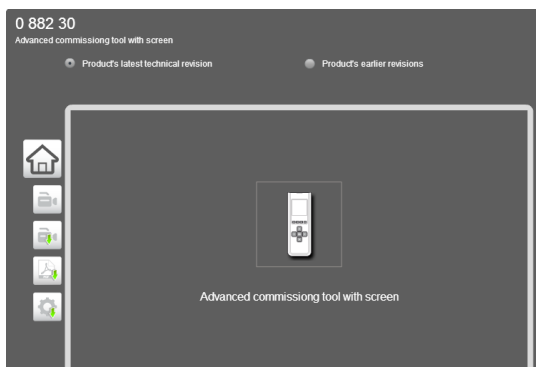

3 Click on the icon  to access software downloading


4. UPDATING (CONTINUED)

4 Download the file

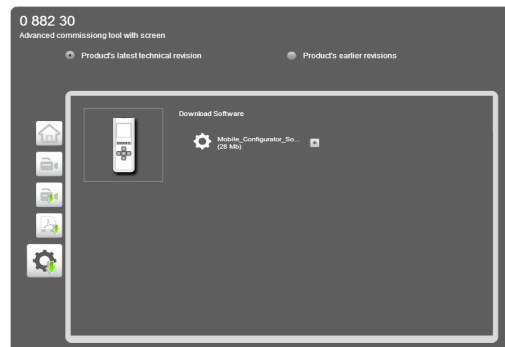


5 Install the updating file


6 Click on **Yes**

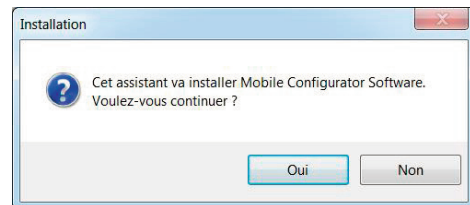


7 Click on **Yes**

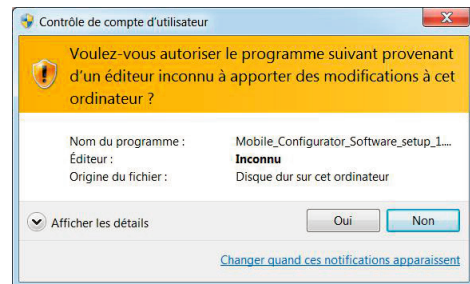

8 Select the desired language then click **OK**

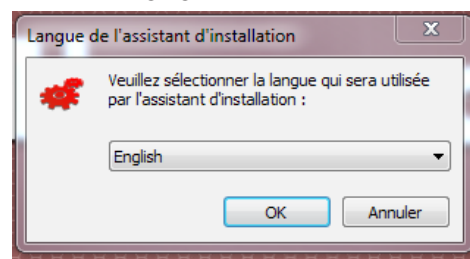

9 Click on **Next**

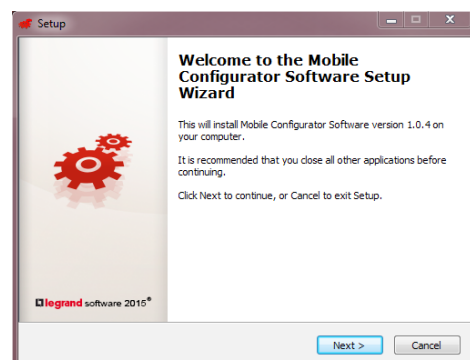


4. UPDATING (CONTINUED)

10 Click on Next after accepting the licence contract terms




11 Click on **Browse** to indicate the destination directory

12 Click on **Next**

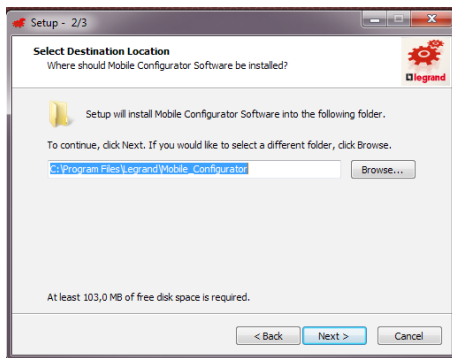


13 To create a software icon on your desktop, check the corresponding box, then click on **Next**

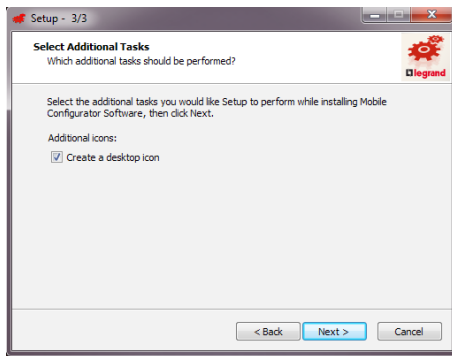


This window summarises the tasks selected earlier

14 Click on **Install** to confirm these actions, or else on Previous to amend these tasks

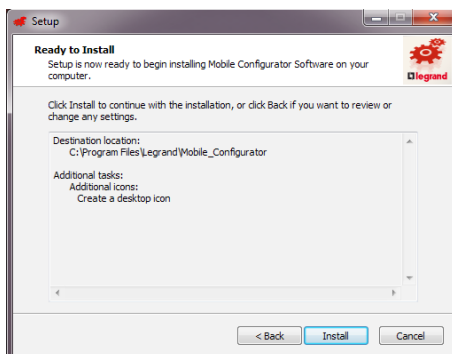


4. UPDATING (CONTINUED)

This window is used to display the progress of the software installation

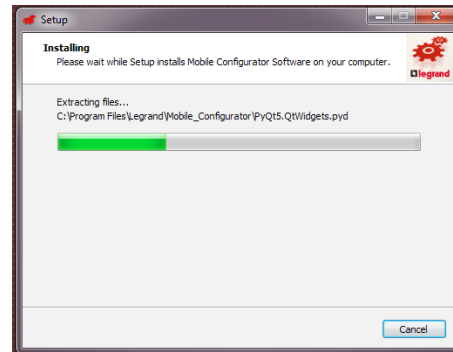


15 Select "Install this driver software anyway"

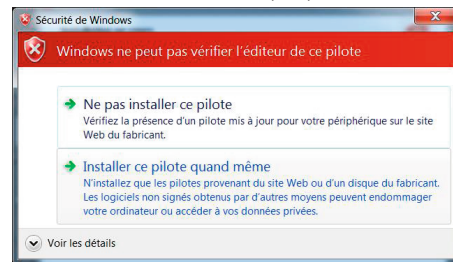

Installation is complete

16 Click on **Finish**

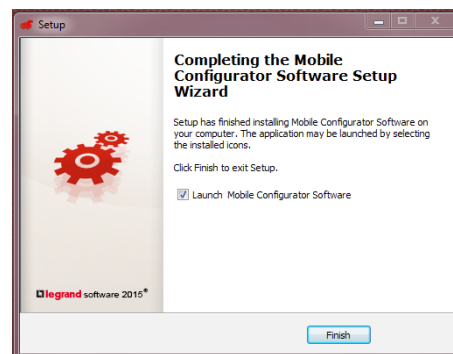


4.2 Launching the software

1 Launch the application shortcut on the Desktop




4. UPDATING (CONTINUED)

2 Select the application

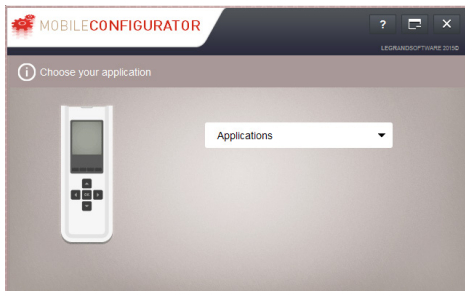

3 Eg: Lighting management

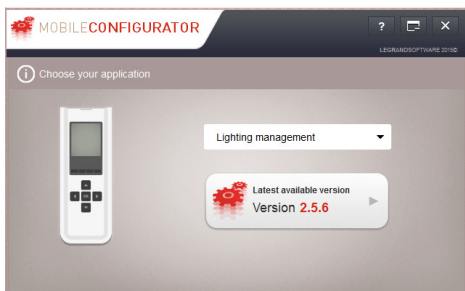

4 Connect the configuration tool to the PC




Important: The configuration tool must be switched off

5 Choose whether or not to start updating





Once connected, the configuration tool should switch on. If not, disconnect and then reconnect it to the USB cable.

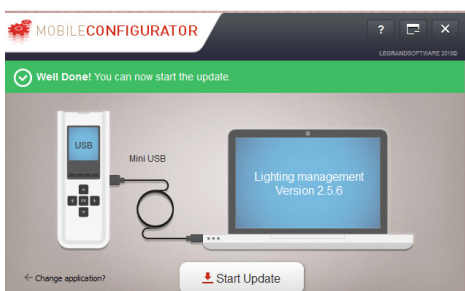

4. UPDATING (CONTINUED)

Alert window warning that some data may be lost. Select **Continue** to start updating.

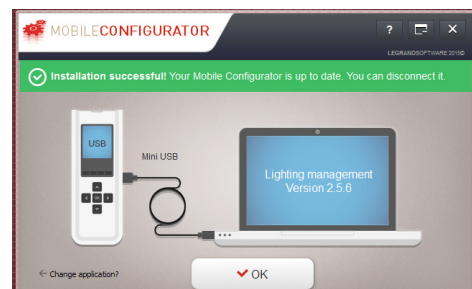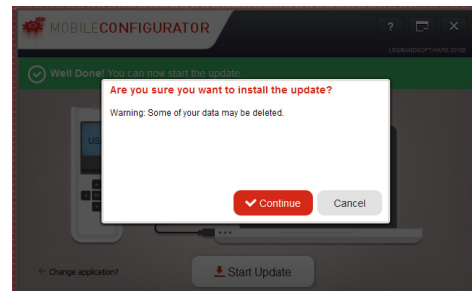

Updating is complete.

Note: All technical information is available on www.legrandoc.com

5. STANDARD EN12464-1 RECOMMENDATIONS

Commercial premises - office buildings:

- Passage areas and corridors: 100 lux
- Stairs: 150 lux
- Canteens: 200 lux
- First-aid room: 500 lux
- Warehouse: 100 lux
- Offices: 300 - 500 lux
- Conference rooms: 500 lux
- Reception rooms: 300 lux
- Technical drawing: 750 lux

Manufacturing areas:

- Packaging rooms: 300 lux
- Visual work during manufacturing: 1000 lux
- Assembly line: 1500 lux

Warehouses:

- Sales areas: 300 lux
- Checkout areas: 500 lux

Other examples:

- Moonlit night: 0.5 lux
- Well-lit street at night: 20 - 70 lux
- Living premises: 100 - 200 lux
- Well-lit apartment: 200 - 400 lux
- Work premises: 200 - 3000 lux
- Stadium at night: 1500 lux
- Outside with cloudy sky: 25,000 lux
- Outside in full sunshine: 50,000 to 100,000 lux

6. CARE

Do not use: acetone, tar-removing cleaning agents or trichloroethylene.

Resistant to the following products: - Hexane (En 60669-1)

- Methylated spirit
- Soapy water
- Diluted ammonia
- Bleach diluted to 10%
- Window-cleaning products

WARNING: Always test before using other special cleaning products.

7. STANDARDS

Directive: CE

Product standard: EN 60 669-2-1

Environmental standards:

- European Directive 2002/96/EC:
WEEE (Waste Electrical and Electronic Equipment)
- European Directive 2002/95/EC:
RoHS (Restriction of Hazardous Substances)